



POSS Cleanroom Test Result

Type.	Cleanroom	Type.	Cleanroom
Volume	290 m³	Exposure	120 min
Disinfectant	3,915 ml	Venting	30 min
Fogging Time	124 min	Device Quantity	1 ea

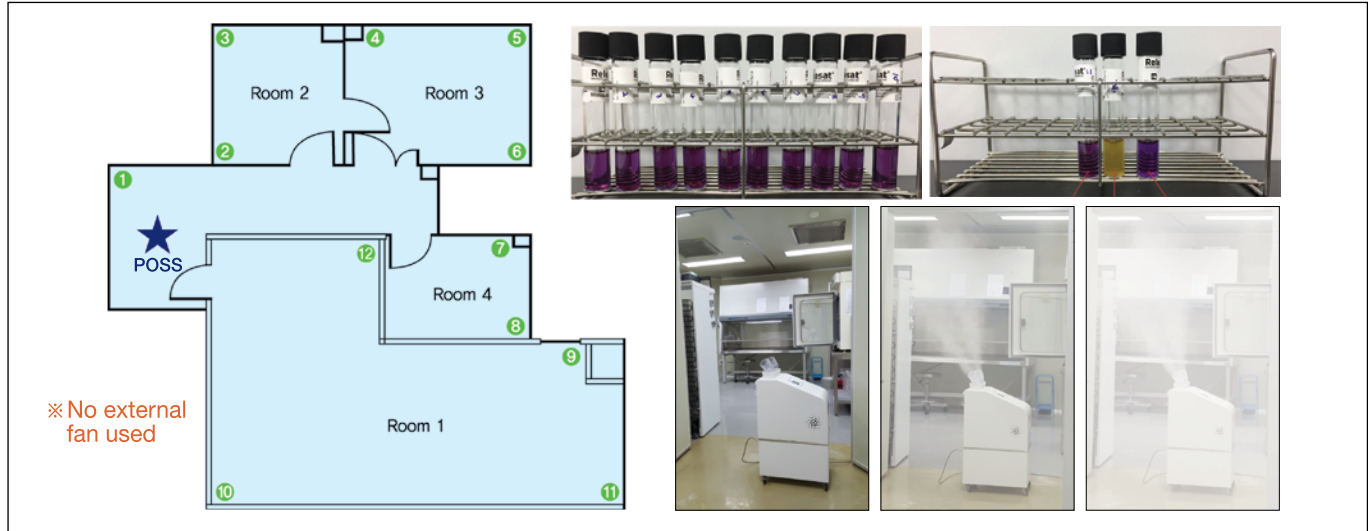

POSS Passbox Test Result

Type.	Passbox	Type.	Passbox
Volume	2 m³	Exposure	60 min
Disinfectant	29 ml	Venting	30 min
Fogging Time	4 min	Device quantity	1 ea

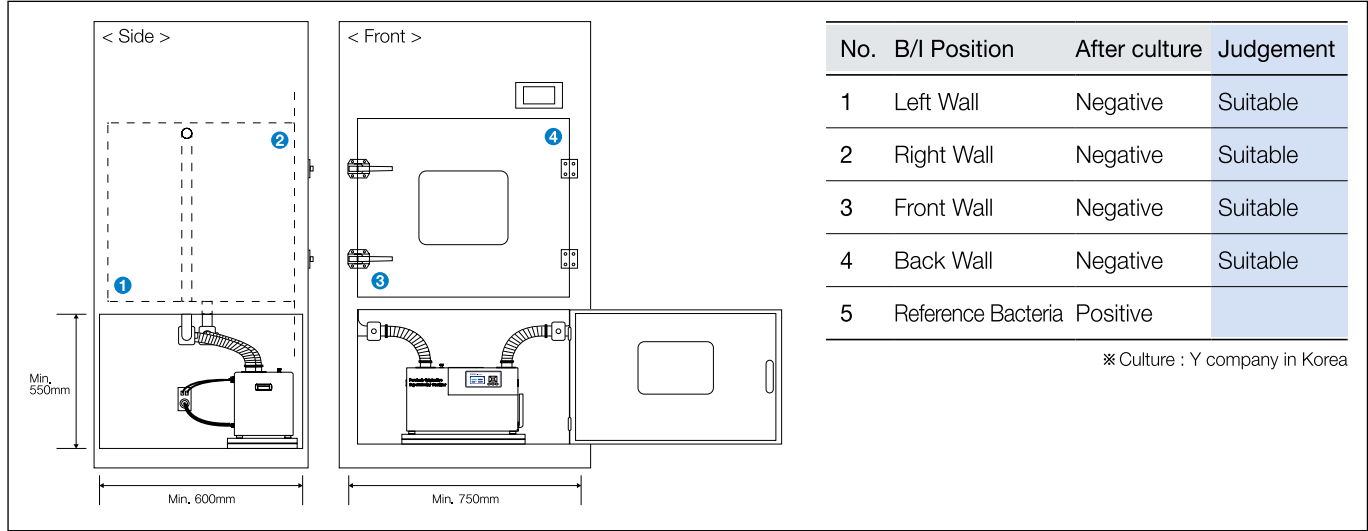

POSS Characteristics

